

A4D400-AP16-17

AC axial fan

sickled blades (S series)



Nominal data

Type	A4D400-AP16-17				
Motor	M4D074-EI				
Phase		3~	3~	3~	3~
Nominal voltage	VAC	400	400	400	400
Connection		Δ	Y	Δ	Y
Frequency	Hz	50	50	60	60
Type of data definition		fa	fa	fa	fa
Valid for approval / standard		CE	CE	CE	CE
Speed	min ⁻¹	1440	1300	1670	1360
Power input	W	170	115	210	160
Current draw	A	0.53	0.21	0.44	0.27
Max. back pressure	Pa	150	100	120	60
Min. ambient temperature	°C	-40	-40	-40	-40
Max. ambient temperature	°C	35	65	45	50

ml = max. load · me = max. efficiency · fa = running at free air · cs = customer specs · cu = customer unit
Subject to alterations

Data according to ErP directive

		Actual	Request 2013	Request 2015
Installation category	A			
Efficiency category	Static			
Variable speed drive	No			
Specific ratio*	1.00			
Overall efficiency η_{es}		31.6	25.5	29.5
Efficiency grade N		42.1	36	40
Power input P_e	kW	0.22		
Air flow q_v	m ³ /h	2610		
Pressure increase p_{fs}	Pa	100		
Speed n	min ⁻¹	1400		

Data established at point of optimum efficiency

A4D400-AP16-17


AC axial fan

sickled blades (S series)

Technical features


Mass	4.18 kg
Size	400 mm
Surface of rotor	Coated in black
Material of blades	Sheet steel, coated in black
Number of blades	5
Direction of air flow	"A"
Direction of rotation	Clockwise, seen on rotor
Type of protection	IP 44; Depending on installation and position as per EN 60034-5 The IP protection is guaranteed only if the provided cable guard and terminal box are installed.
Insulation class	"B"
Humidity class	F2-2
Max. permissible ambient motor temp. (transp./ storage)	+ 70 °C
Min. permissible ambient motor temp. (transp./storage)	- 40 °C
Mounting position	Shaft horizontal or rotor on bottom; rotor on top on request
Condensate discharge holes	Rotor-side
Operation mode	S1
Motor bearing	Ball bearing with anti-freezing grease
Touch current acc. IEC 60990 (measuring network Fig. 4, TN system)	< 0.75 mA
Electrical leads	Prepared for terminal box installation/assembly
Motor protection	Thermal overload protector (TOP) brought out
Cable exit	Variable
Protection class	I (if protective earth is connected by customer)
Product conforming to standard	EN 60335-1; CE

Product drawing

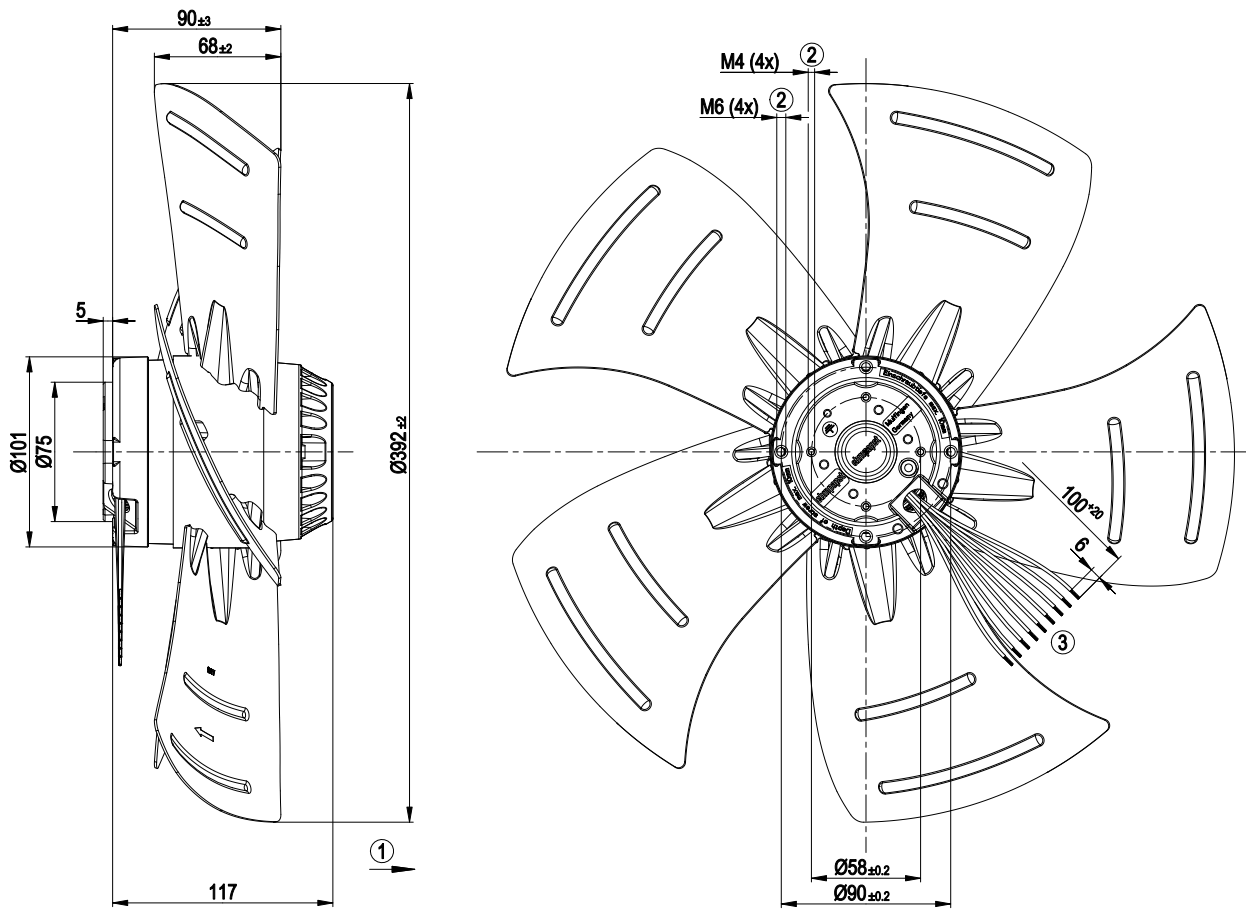

1	Direction of air flow "A"
2	Depth of screw max. 10 mm
3	Connection line Dipotherm 9G 0.5mm ² , 9x brass lead tips crimped


Connection screen

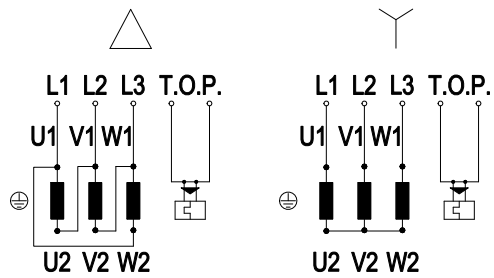

Note: Direction of rotation changes when two phases are reversed

Δ	Delta-connection	Y	Star connection	L1	black
L2	blue	L3	brown	U1	black
V1	blue	W1	brown	U2	green
V2	white	W2	yellow	TOP	grey

Charts: Air flow 50 Hz

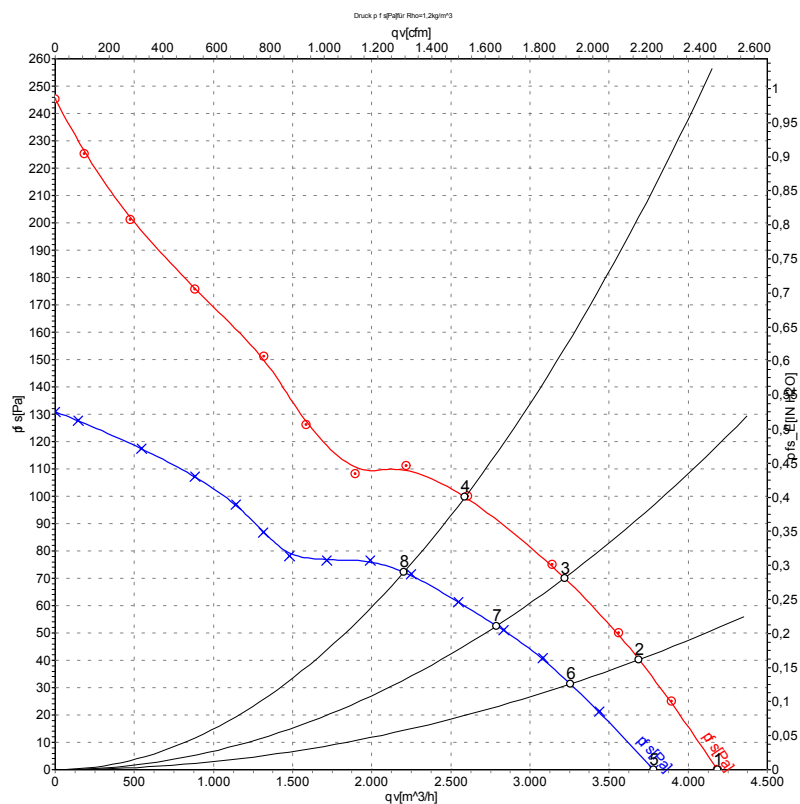

Measurement: LU-43060
Measurement: LU-51669


Air performance measured as per ISO 5801 Installation category A. For detailed information on the measuring set-up, please contact ebm-papst. Suction-side noise levels: L_{WA} measured as per ISO 13347 / L_{pA} measured with 1m distance to fan axis. The values given are valid under the measuring conditions mentioned above and may vary according to the actual installation situation. With any deviation from the standard set-up, the specific values have to be checked and reviewed with the unit installed.

Measured values

	Conn.	U	f	n	P _e	I	qv	p _{fs}
		V	Hz	min ⁻¹	W	A	m ³ /h	Pa
1	Δ	400	50	1440	170	0.53	4185	0
2	Δ	400	50	1425	192	0.51	3690	40
3	Δ	400	50	1415	211	0.51	3220	70
4	Δ	400	50	1400	229	0.53	2590	100
5	Y	400	50	1300	115	0.21	3780	0
6	Y	400	50	1255	131	0.23	3255	31
7	Y	400	50	1220	145	0.25	2790	53
8	Y	400	50	1180	156	0.27	2205	72

Conn. = Connection · U = Supply voltage · f = Frequency · n = Speed · P_e = Power input · I = Current draw · qv = Air flow · p_{fs} = Pressure increase

Charts: Air flow 60 Hz

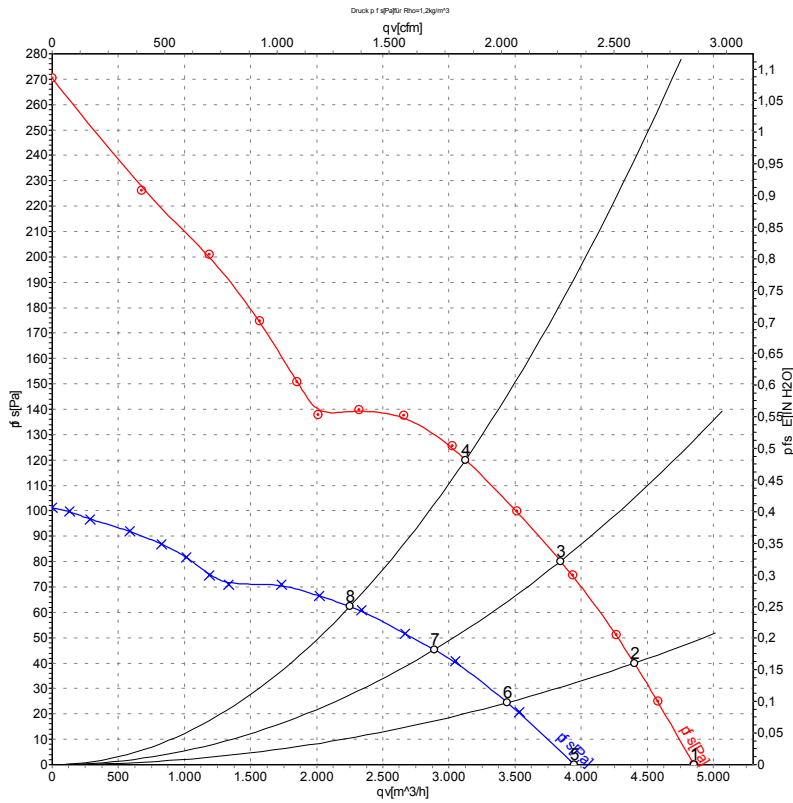

Measurement: LU-43061
Measurement: LU-51672

Air performance measured as per ISO 5801 Installation category A. For detailed information on the measuring set-up, please contact ebm-papst. Suction-side noise levels: LwA measured as per ISO 13347 / LpA measured with 1m distance to fan axis. The values given are valid under the measuring conditions mentioned above and may vary according to the actual installation situation. With any deviation from the standard set-up, the specific values have to be checked and reviewed with the unit installed.

Measured values

	Conn.	U	f	n	Pe	I	qv	Pfs
		V	Hz	min ⁻¹	W	A	m ³ /h	Pa
1	Δ	400	60	1670	210	0.44	4850	0
2	Δ	400	60	1650	245	0.47	4400	40
3	Δ	400	60	1625	279	0.51	3845	80
4	Δ	400	60	1600	311	0.55	3125	120
5	Y	400	60	1360	160	0.27	3950	0
6	Y	400	60	1280	173	0.29	3440	25
7	Y	400	60	1205	185	0.32	2890	45
8	Y	400	60	1135	195	0.33	2250	62

Conn. = Connection · U = Supply voltage · f = Frequency · n = Speed · Pe = Power input · I = Current draw · qv = Air flow · Pfs = Pressure increase